


單一測點報表(60分):試驗藥局 2-8℃冰箱A溫度5010107-000517

2024/09/01 00:00-2024/10/01 05:00

27/27

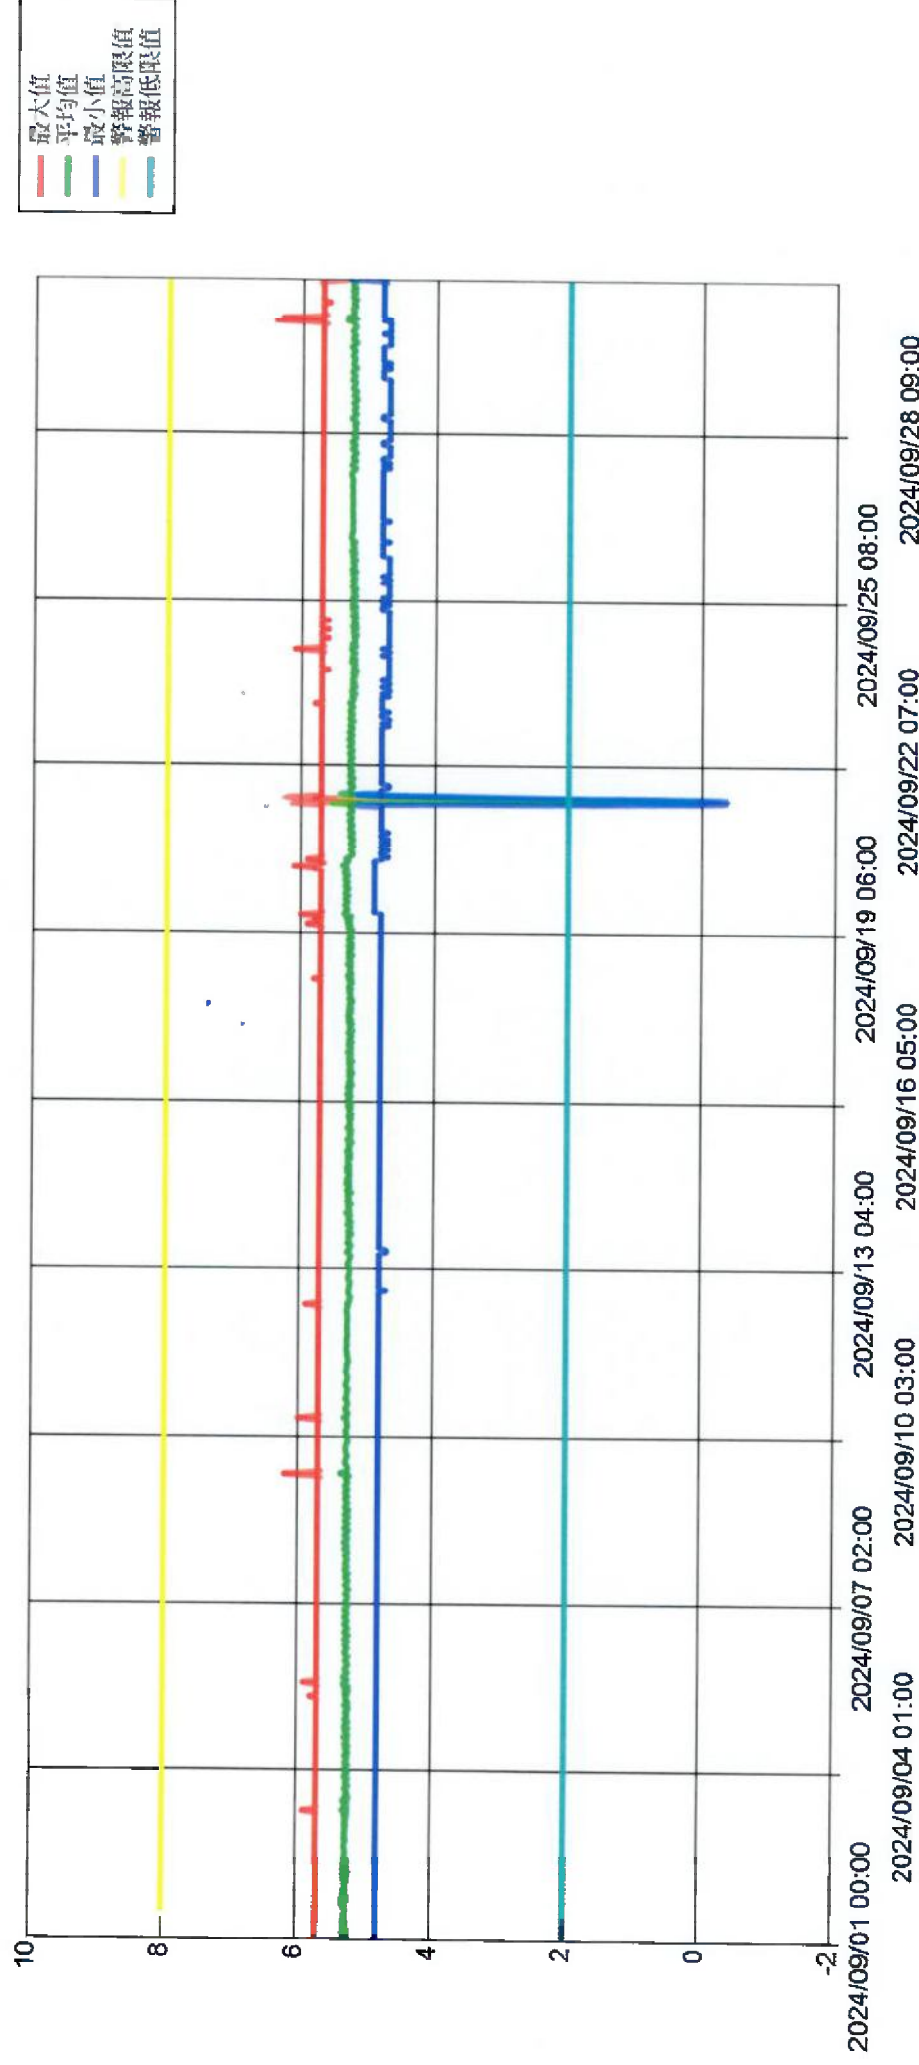


2024/9/21 15:57-17:25 癌醫大樓進行斷電測試,臨床試驗藥局藥櫃與溫度監測系統皆不受影響,但因網路訊號斷訊,造成溫濕度數值無法讀取而被記錄成"0"度。第2頁為 冰箱 A 的 backup 溫度紀錄,顯示斷訊當下,溫度不受影響,無超溫。

ys-chen tan
01. oct. 2024

藥師徐儀君
藥字第026959號

[註]

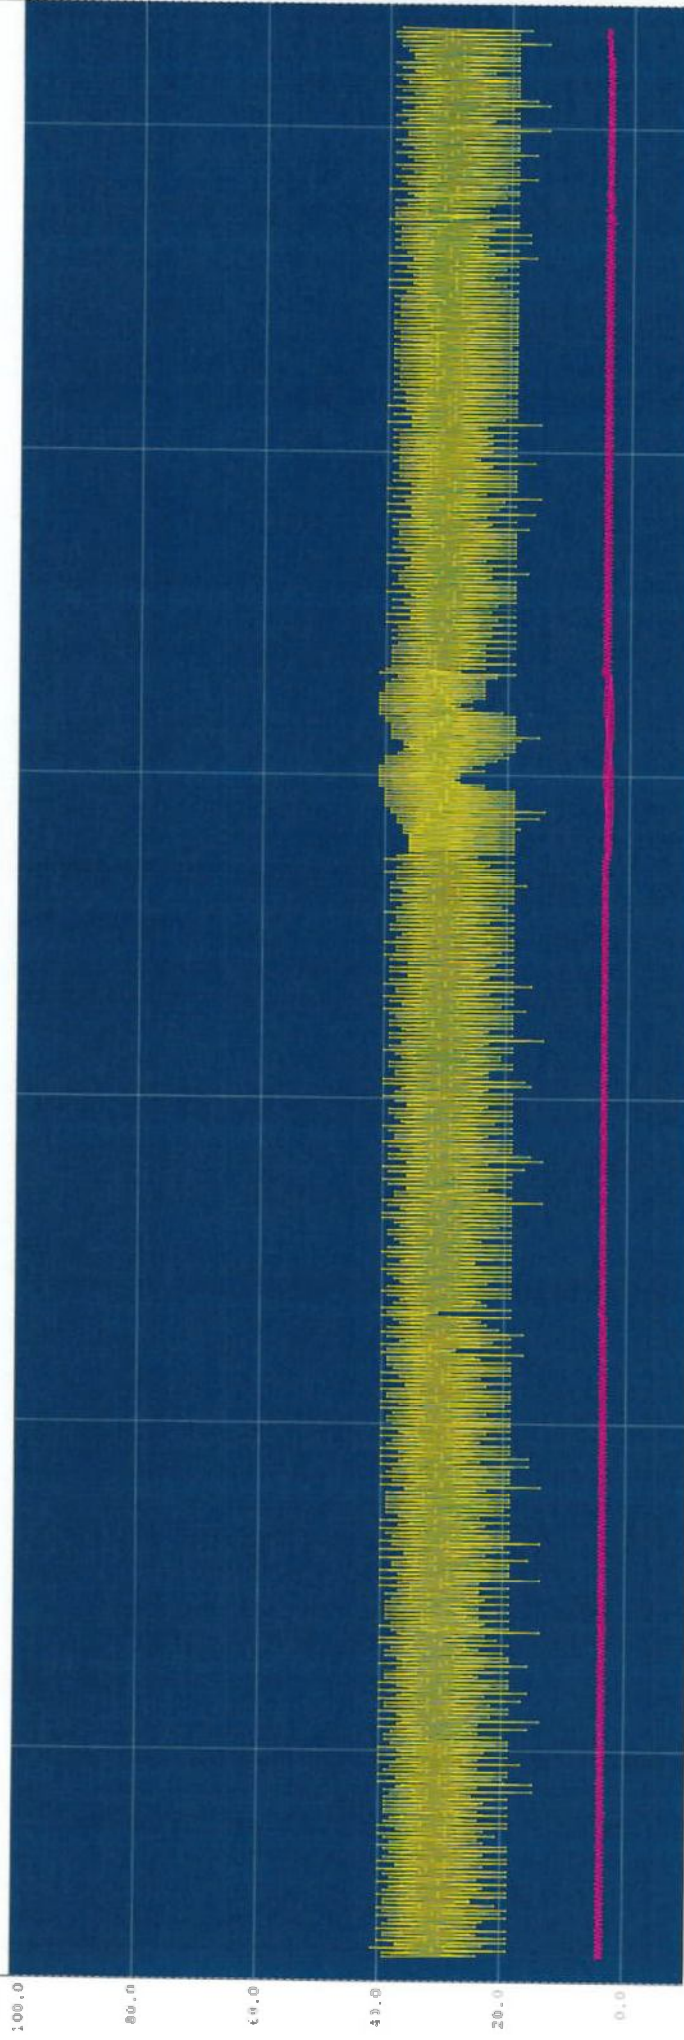

09/21/24		09/23/24		09/25/24		09/27/24		09/29/24		10/01/24	
0:00:00		0:26:00		0:00:00		0:00:00		0:30:00		0:00:00	
ch	Name	Intvl.	Sample	Cur.A	Cur.B A<->B	High	Low	Avg.	Unit		
1	Ch1	10min.	1714	-----	-----	-----	4.6	2.8	3.8	此引	
2	Ch2	10min.	1714	-----	-----	-----	41	14	30.0	此H	
Cur.A Date : 09/19/2024 14:04'17											
Cur.B Date : 10/01/2024 18:25'44											
diff. A-B : 12 04:21'27.000											
Data Range 09/19/2024 14:04'17-10/01/2024 18:25'44											
Calc.Range 09/19/2024 17:29'50-10/01/2024 15:00'11											