


2024/09/01 00:00-2024/10/01 05:00

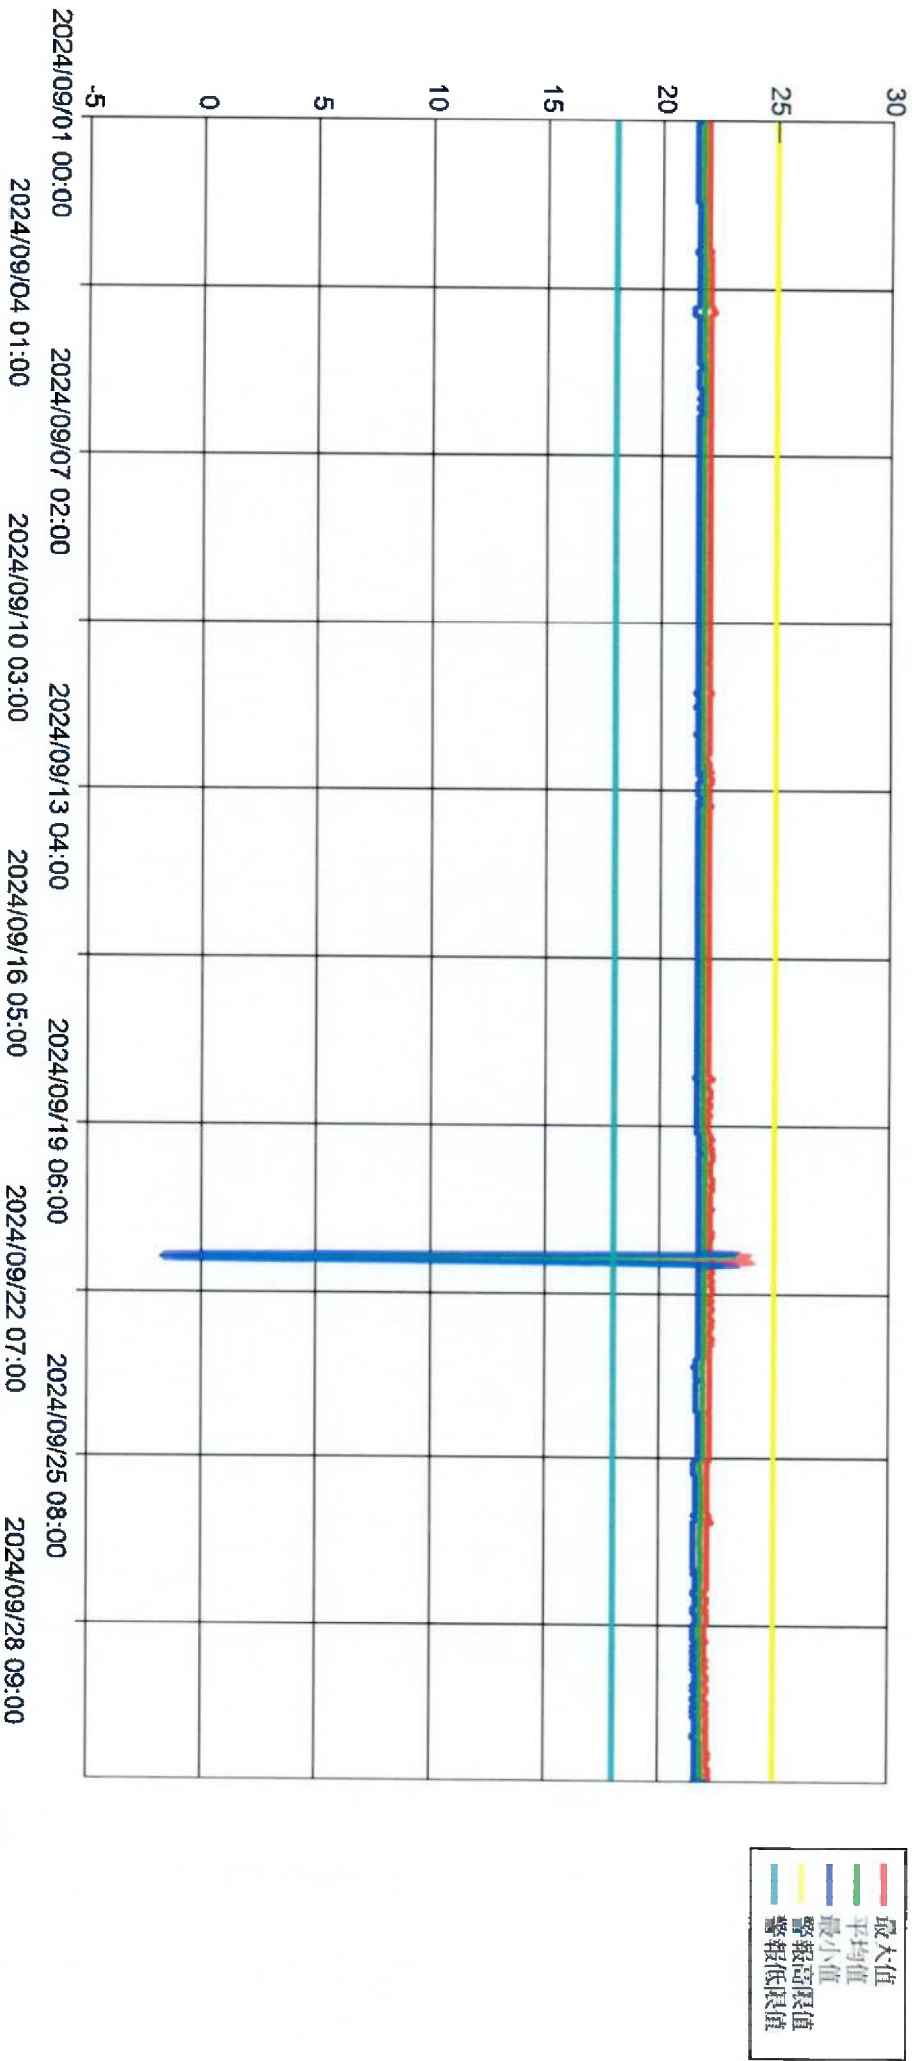


2024/9/21 15:57-17:25 癌醫大樓進行斷電測試,臨床試驗藥局藥櫃與溫度監測系統皆不受影響,但因網路訊號斷訊,造成溫濕度數值無法讀取而被記錄成"0"度。第2頁為 室溫櫃 A 的 backup 溫度紀錄,顯示斷訊當下,溫度不受影響,無超溫。

Ys-ward-tn

01. oct. 2024

藥師徐儀君
藥字第026959號

25/11/20

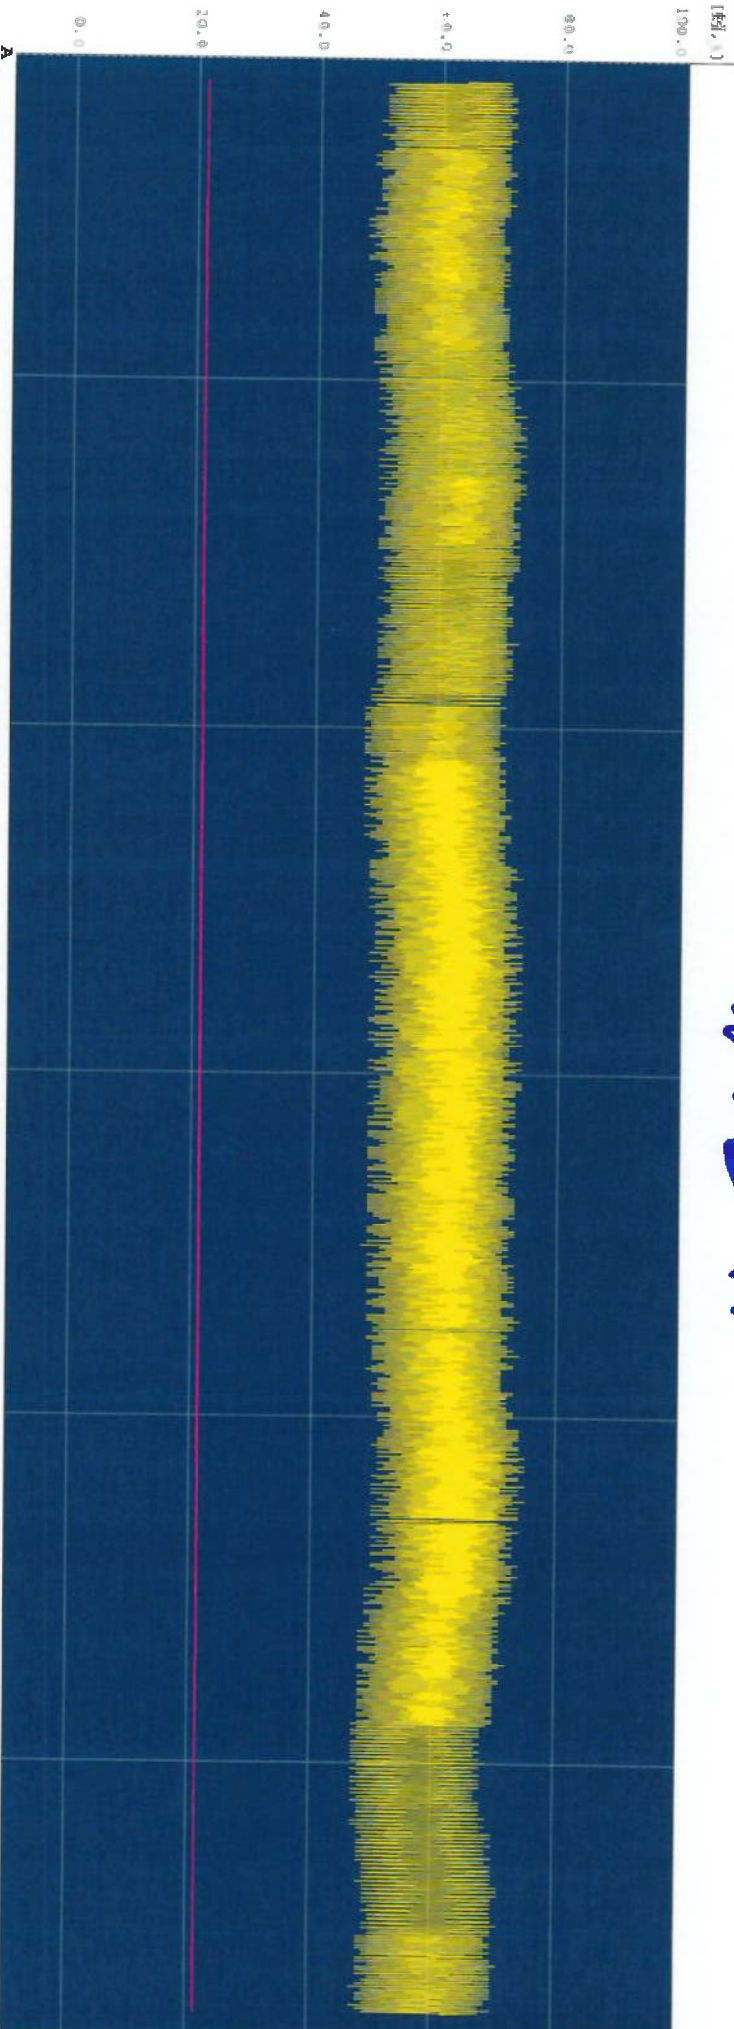

Ch	Name		Intvl.	Sample	Cur.A	Cur.B	A<->B	High	Low	Avg.	Unit
1	Ch1	10min.		4021	----	-----	-----		21.7	21.2	21.4 \$Jl
2	Ch2	16min.		4021	----	-----	-----		75	47	61.5 #RH
Cur.A Date : 09/03/2024 8:57'26											
Cur.B Date : 10/01/2024 23:02'35											
diff. A-B : 28 14:05'09.000											
Data Range 09/03/2024 8:57'26-10/01/2024 23:02'35											
Calc.Range 09/03/2024 16:59'50-10/01/2024 15:00'11											